



Calder Plaza

Restrictions and Guidelines

- The OSE must have a Site-map showing how the event will be laid out.
- All sound checks must be conducted below 85 decibels.
- Any tape, rope, signs, wire or hangers which have been placed on the ground, buildings, columns, windows, poles, etc., will be completely removed after the event. If it is not, you will be charged out of your deposit.
- If cooking with oil, vendors must have something underneath the cooking area to prevent grease from accumulating on the surface/ground. If there is grease left behind, your event will have to power wash any surface left uncleaned.
- The venue must be cleaned and left the way you found it.
- Building access for any reason outside public hours is not permitted unless the building has been rented.
- The south plaza entrance gate must be closed and locked when loading, unloading, setup/teardown is not being performed. Gates should be closed and locked each night.

Tents:

- There are various tent anchor configurations available for large tents. For small tents you must use water barrels to secure.

Vehicles:

- All vehicles must have a permit. Make sure all staff/volunteers have pass from Parking Services in their car window before parking (even in front of hooded meters) or they will be

ticketed if they do not follow standard procedures.

- Only vehicles allowed are those picking up or dropping off items during set up/take down. Organizers are required to develop a list of authorized vendors and a timetable that illustrates arrival and departure times for vendors and provide it to the OSE.
- No vehicles are allowed to use the north entrance to Calder.
- No vehicles weighing over 20,000 lbs are allowed on the plaza.
- Do not allow staff/volunteers to double park in the street.


Water: (see map on back)


- There is a hook up at the south side wall of the plaza and another at the north side wall and will require a key to access them. Portable water hoses are required.

Electrical: (see map on back)

- Electrical cords are not to be strung across walkways or over mounds. This creates a safety hazard.
- There are six light poles on the plaza and each provides 2 Hubble 240V-50 amp outlets and one 120V GFI plug rated at 20 amps.
- There are four electrical source boxes all equipped with breakers for each outlet.
- There are 28 outlets along the site and 10 power panels.

*** All other rules still apply that are posted within the park**

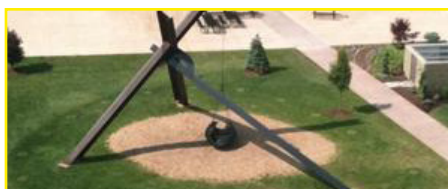

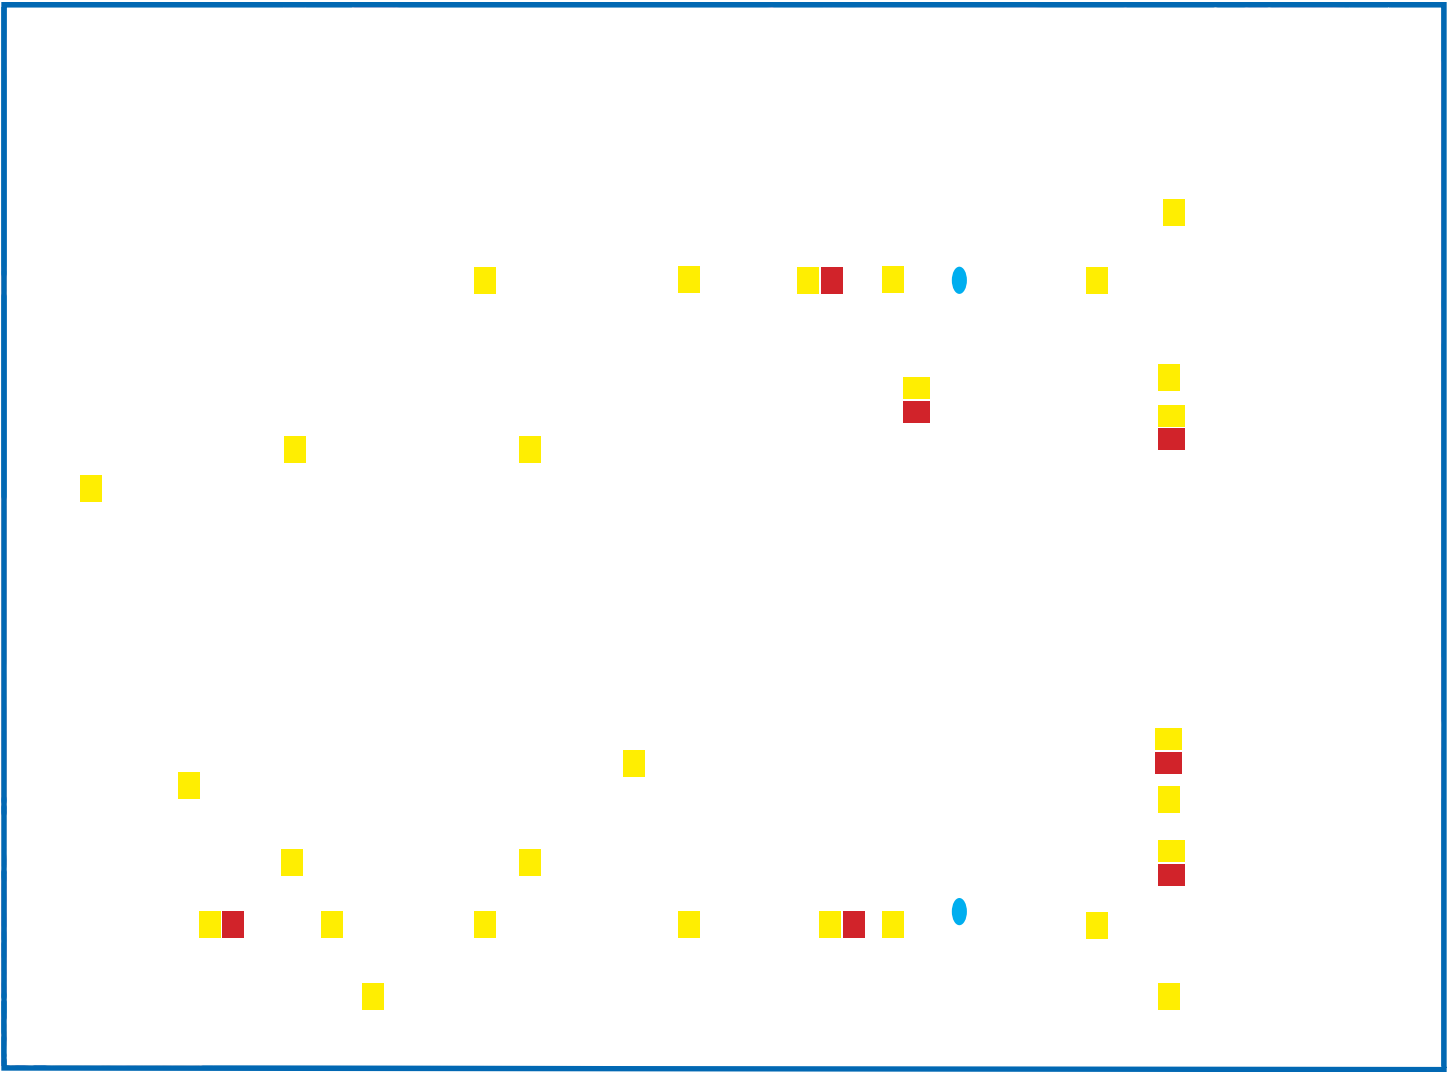

● Water hook-up ■ 20amp 110V ■ 50amp 220V

We Make Things Happen

1 Monroe Center NW #L145 Grand Rapids, MI 49503 • 616.456.3378 • www.grcity.us

